


PLAN VIEW

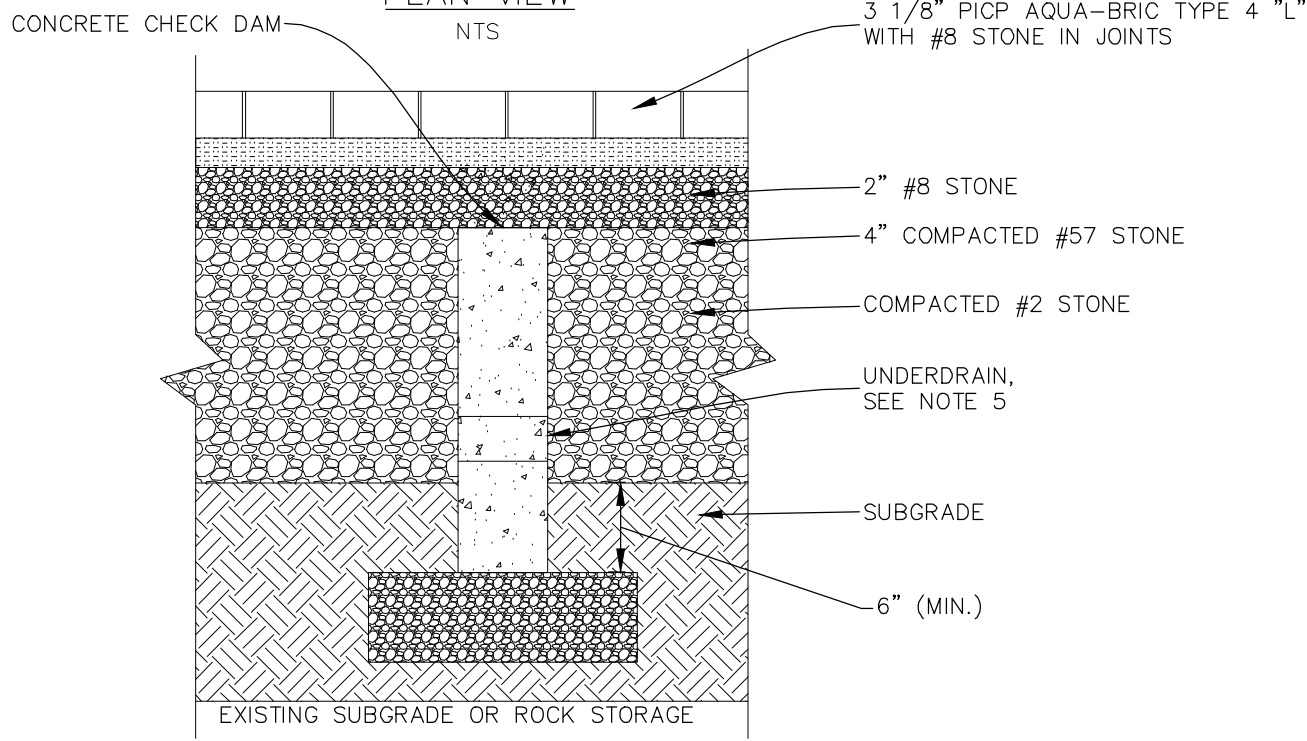

TYPICAL SECTION 'A-A'

NTS

NOTES:

1. LOCATIONS, HEIGHT, AND WIDTHS OF CHECK DAMS TO BE SPECIFIED IN THE DESIGN PLANS.
2. CONCRETE CHECK DAM SHALL BE CONTINUOUS (NO JOINTS).
3. EMBED #3 REBAR 3" MIN. INTO CURB ON BOTH SIDES (2 PER SIDE).
4. DEPTH OF CHECK DAM VARIES DEPENDING ON THE DEPTH OF THE FACILITY.
5. IF PRESENT, UNDERDRAIN TO PASS THROUGH CHECK DAM IN A NON-PERFORATED PVC PIPE.

MODIFICATIONS OF DRAWINGS ARE ONLY PERMITTED BY WRITTEN AUTHORIZATION FROM EAGLE BAY

DATE: 05-01-15

DWG: 10 OF 14



SWM PAVE
CONCRETE CHECK DAM